

FEATURES

- 3 fan speed control outputs
- 2 configurable outputs as open/close valves or a 3-point valve*
- 2 configurable outputs as a second 3-point valve*, individual outputs or a shutter channel**
- 6 analog/digital inputs
- Manual output operation with push button and LED status indicator
- Logic functions
- Output timing functionality
- Total data saving on KNX bus failure
- Integrated KNX BCU
- Dimensions 67 x 90 x 79mm (4.5 DIN units)
- DIN rail mounting according to IEC 60715 TH35, with fixing clamp
- Possibility of connecting different phases in adjacent outputs
- Conformity with the CE directives (CE-mark on the right side)

* Depends on the application program version

** Suitable for capacitive loads, maximum 140 µF

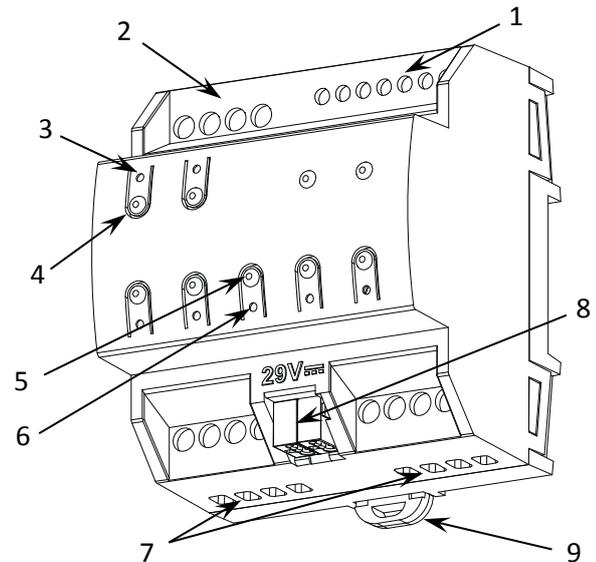


Figure 1: MAXinBOX Hospitality

1. Analog/Digital inputs	2. Fan outputs	3. Output status LED	4. Output control button	5. Programming/Test button
6. Programming/Test LED	7. Valve/Individual/Shutter outputs	8. KNX connector	9. Fixing clamp	

Programming/Test button: short press to set programming mode. If this button is held while plugging the device into the KNX bus, it enters the safe mode. If this button is held for more than 3 seconds, the device enters the test mode.

Programming/Test LED: programming mode indicator (red). When the device enters the safe mode, it blinks (red) every half second. The manual mode is indicated by the green color. During the start-up (reset or after KNX bus failure) and if the device is not in safe mode, it starts a blue blinking sequence.

GENERAL SPECIFICATIONS

CONCEPT		DESCRIPTION		
Type of device		Electric operation control device		
KNX supply	Voltage (typical)	29VDC SELV		
	Voltage range	21..31VDC		
	Maximum consumption	Voltage	mA	mW
		29VDC (typical)	7.48	217
24VDC ¹	10	240		
Connection type		Typical TP1 bus connector for 0.80mm Ø rigid cable		
External power supply		Not required		
Operation temperature		0°C .. +55°C		
Storage temperature		-20°C .. +55°C		
Operation humidity		5 .. 95%		
Storage humidity		5 .. 95%		
Complementary characteristics		Class B		
Protection class / Overvoltage category		II / III (4000V)		
Operation type		Continuous operation		
Device action type		Type 1		
Electrical stress period		Long		
Degree of protection / Pollution degree		IP20 / 2 (clean environment)		
Installation		Independent device to be mounted inside electrical panels with DIN rail (IEC 60715)		
Minimum clearances		Not required		
Response on KNX bus failure		Data saving according to parameterization		
Response on KNX bus restart		Data recovery according to parameterization		
Operation indicator		The programming LED indicates programming mode (red) and test mode (green). Each output LED indicates its status		
Weight		251g		
PCB CTI index		175V		
Housing material / Ball pressure test temperature		PC FR V0 halogen free / 75°C (housing) - 125°C (connectors)		

¹ Maximum consumption in the worst-case scenario (KNX Fan-In model).


OUTPUTS SPECIFICATIONS AND CONNECTIONS	
CONCEPT	DESCRIPTION
Output type / Disconnection type	Potential-free outputs through bistable relays / Micro-disconnection
Outputs per common	Individual/Valve 1 Fan outputs 3
Different phases connection (valve and individual outputs)	Possibility of connecting different phases in adjoining outputs
Connection method	Screw terminal block
Cable cross-section	1.5-4mm ² (IEC) / 26-10AWG (UL)
F1-3/V1-2 OUTPUTS	
Rated current per output	AC 8(4)A @ 250VAC (2000VA) DC 5A @ 30VDC (150W)
Maximum load per output	Resistive 2000W Inductive 1000VA
Mechanical lifetime (min. cycles)	1 000 000
O1-2 OUTPUTS	
Rated current per output	AC 16(6)A @ 250VAC (4000VA) DC 7A @ 30VDC (210W)
Maximum load per output	Resistive 4000W Inductive 1500VA
Maximum inrush current	800A/200μs 165A/20ms
Maximum response time	10ms
Mechanical lifetime (min. cycles)	3 000 000

INPUTS SPECIFICATIONS AND CONNECTIONS	
CONCEPT	DESCRIPTION
Number of inputs	6
Inputs per common	6
Operation voltage	+3.3VDC in the common
Operation current	1mA @ 3.3VDC (per input)
Switching type	Dry voltage contacts between input and common
Connection method	Screw terminal block
Cable cross-section	1-2.5mm ² (IEC) / 26-12AWG (UL)
Maximum cable length	30m
NTC probe length	1.5m (extensible up to 30m)
NTC accuracy (@ 25°C)	±0.5°C
Temperature resolution	0.1°C
Maximum response time	10ms


INPUTS CONNECTION

Any combination of the following accessories is allowed in the inputs:

Temperature Probe

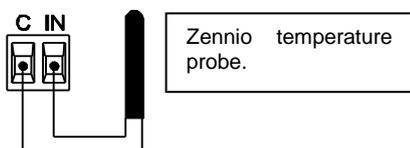


Motion Sensor

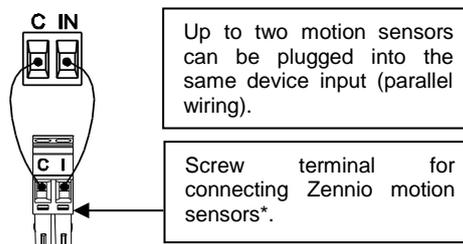

* In case of using ZN110-DETEC-P sensor, its micro switch number 2 must be in **Type B position**.

Switch/Sensor/ Push button



⚠ Commons of different devices must not be connected together.

WIRING DIAGRAMS

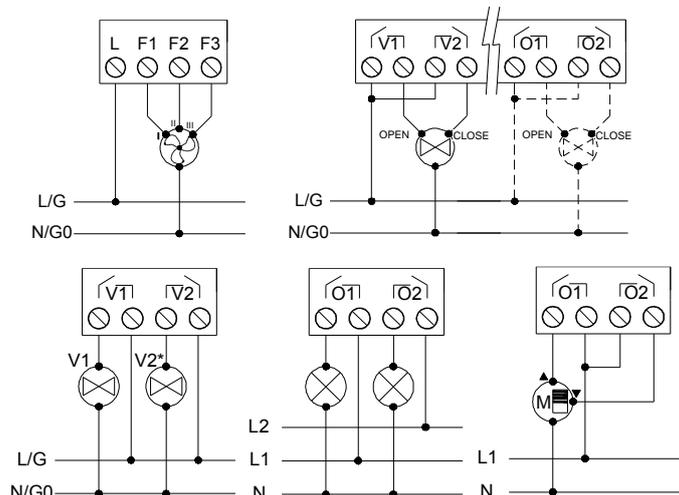


Figure 2: Wiring example (from top to bottom and left to right): Three-speed fan, 1 or 2 three-point valves**, 2 open/close valves, 2 loads connected to different phases and shutter channel.


* In case of 2-pipe fancoil (only one open/close valve), V2 can be used as an individual output (up to 8A and not capacitive load).

** Depends on the application program version.


For 4-pipe fancoil, the cooling valve should always be connected at the left side and the heating valve at the right side. Before the start-up of the device it must be assured that the valve is completely closed.

⚠ In order to ensure the expected status of the relays, please check that the device is connected to the KNX bus before energizing the power circuit.

Attaching MAXinBOX Hospitality to DIN rail:

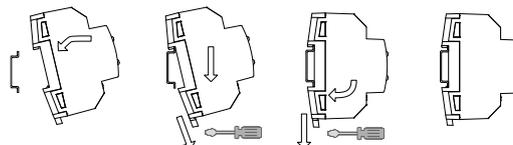

Removing MAXinBOX Hospitality from DIN rail:

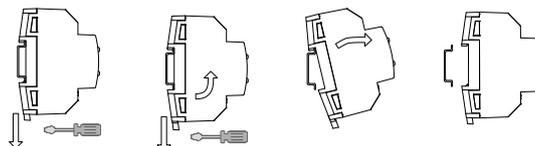

SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point of the KNX bus; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the KNX bus or the wires of other accessories, in case of being installed.
- Once the device is installed (in the panel or box), it must not be accessible from outside.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.
- The WEEE logo means that this device contains electronic parts and it must be properly disposed of by following the instructions at <https://www.zennio.com/en/legal/weee-regulation>.