

FEATURES

- 4.1" capacitive touch panel - horizontal installation (320x240 pixels)
- Up to 7 free configurable pages and one more for settings
- Built-in temperature, luminosity and proximity sensors
- Clock functionality (subject to updating through devices with RTC or NTP client)
- 2 independent thermostats
- 4 analog/digital inputs
- Total data saving on KNX bus failure
- Integrated KNX BCU (TP1-256)
- Dimensions 125 x 91 x 11.5 mm
- Flush mount on standard European, Italian, Australian and American mounting box
- Conformity with the CE, UKCA, RCM directives (marks on the back side)

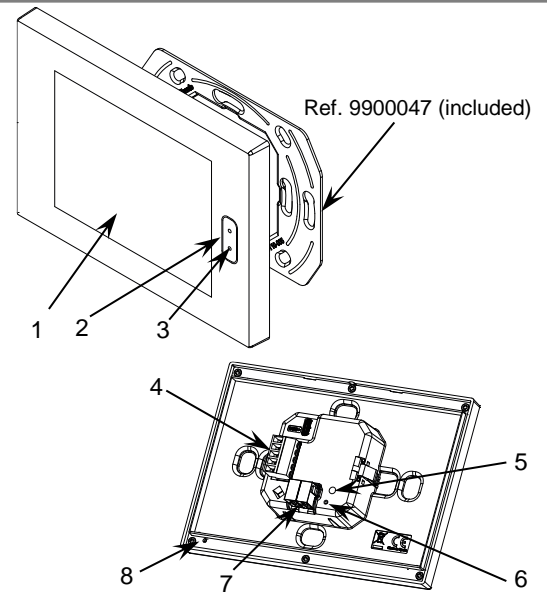


Figure 1: Z40

| | | | |
|-----------------------|----------------------------|-------------------------------------|-----------------------|
| 1. Touch display | 2. Illuminated Home button | 3. Luminosity and proximity sensors | 4. Inputs connector |
| 5. Programming button | 6. Programming LED | 7. KNX connector | 8. Temperature sensor |
| | | | 9. Fixing clips |

Programming button: short press to set programming mode. If this button is held while plugging the device into the KNX bus, it enters the safe mode.

Programming LED: programming mode indicator (red). When the device enters the safe mode, it blinks (red) every half second. During the start-up (reset or after KNX bus failure) and if the device is not in safe mode, it emits a red flash.

GENERAL SPECIFICATIONS

| CONCEPT | | DESCRIPTION | | |
|-------------------------------|---------------------|---|------|-------|
| Type of device | | Electric operation control device | | |
| KNX supply | Voltage (typical) | 29 VDC SELV | | |
| | Voltage range | 21-31 VDC | | |
| | Maximum consumption | Voltage | mA | mW |
| | | 29 VDC (typical) | 18.6 | 539.4 |
| 24 VDC ¹ | 25 | 600 | | |
| Connection type | | Typical TP1 bus connector for 0.8 mm Ø rigid cable | | |
| External power supply | | Not required | | |
| Operation temperature | | 0 .. +55 °C | | |
| Storage temperature | | -20 .. +55 °C | | |
| Operation humidity | | 5 .. 95% | | |
| Storage humidity | | 5 .. 95% | | |
| Complementary characteristics | | Class B | | |
| Protection class | | III | | |
| Operation type | | Continuous operation | | |
| Device action type | | Type 1 | | |
| Electrical stress period | | Long | | |
| Degree of protection | | IP20, clean environment | | |
| Installation | | Flush mount on back box | | |
| Minimum clearances | | Not required | | |
| Response on KNX bus failure | | Data saving according to parameterization | | |
| Response on KNX bus restart | | Data recovery according to parameterization | | |
| Operation indicator | | The programming LED indicates programming mode (red). Display allows visual functionality feedback. | | |
| Weight | | 169 g | | |
| PCB CTI index | | 175 V | | |
| Housing material | | PC+ABS FR V0 halogen free | | |

¹ Maximum consumption in the worst-case scenario (KNX Fan-In model).

| INPUTS SPECIFICATIONS AND CONNECTIONS | |
|---------------------------------------|---|
| CONCEPT | DESCRIPTION |
| Number of inputs | 4 |
| Inputs per common | 4 |
| Operation voltage | +3.3 VDC in the common |
| Operation current | 1 mA @ 3.3 VDC (per input) |
| Switching type | Dry voltage contacts between input and common |
| Connection method | Pluggable screw terminal block (0.3 Nm max.) |
| Cable cross-section | 0.2-1 mm ² (IEC) / 26-16 AWG (UL) |
| Maximum cable length | 30 m |
| NTC probe length | 1.5 m (extensible up to 30 m) |
| NTC accuracy (@ 25 °C) ² | ±0.5 °C |
| Temperature resolution | 0.1 °C |
| Maximum response time | 10 ms |


² For Zennio temperature probes.

| TEMPERATURE SENSOR SPECIFICATIONS | |
|-----------------------------------|---------------|
| CONCEPT | DESCRIPTION |
| Measuring range | -10 .. +50 °C |
| Temperature resolution | 0.1 °C |
| NTC accuracy (@ 25 °C) | 1% |


INPUTS CONNECTION

Any combination of the following accessories is allowed in the inputs:


Temperature Probe**

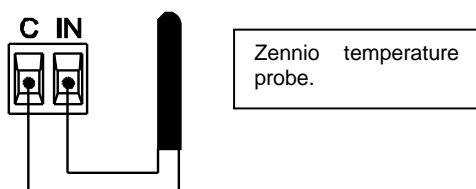

Motion Sensor

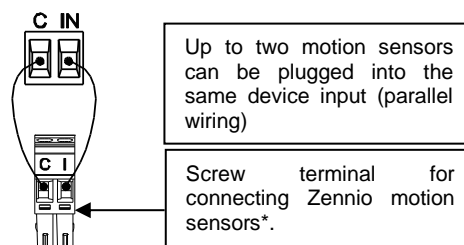

Switch/Sensor/ Push button

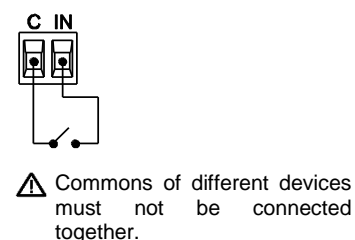


* In case of using ZN110-DETEC-P sensor, its micro switch number 2 must be in **Type B position**.


** Zennio temperature probe or any NTC with known resistance values at three points in the range [-55, 150 °C].

INSTALLATION INSTRUCTIONS

1. Fix the metal plate into a square or round back box by using the screws from the box, checking that it is levelled. It must be horizontally oriented (home button on the right side).
2. Connect the KNX bus and the inputs terminal to the back of the device.
3. Fit the device into its final position checking that clips strength is enough to fix the device.

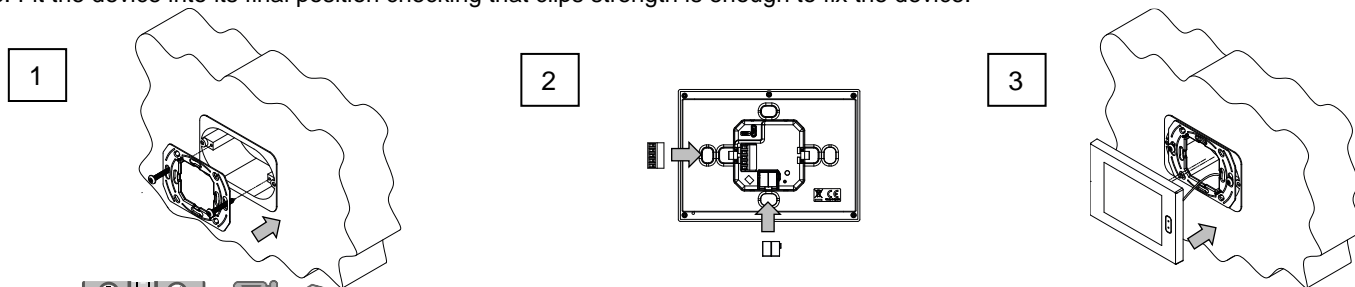

DIMENSIONS (mm)

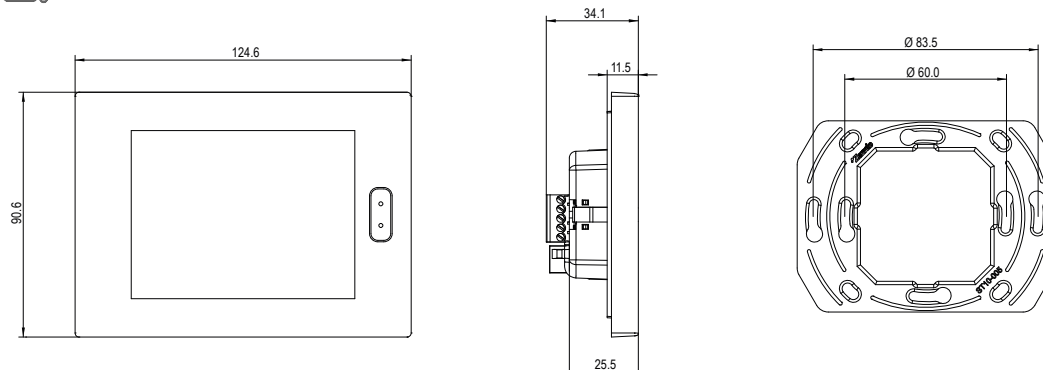

SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point of the KNX bus; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the KNX bus or the wires of other accessories, in case of being installed.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.
- The WEEE logo means that this device contains electronic parts and it must be properly disposed of by following the instructions at <https://www.zennio.com/en/legal/wEEE-regulation>.
- This device contains software subject to specific licences. For details, please refer to <https://zennio.com/licenses>.